

APC™ Smart-UPS™ Modular Ultra Power Distribution Unit (PDU)

DANGER


RISK OF ELECTRIC SHOCK

- PDUs should be replaced only by qualified service personnel.
- Switch off the electrical panel circuit breaker before attempting to replace the PDUs.
- Remove all battery modules (if installed) before attempting to replacing the PDUs.
- Be sure that either the Power Distribution Unit (PDU) or the PDU blanking panel is positioned correctly and secured before connecting the unit to AC Mains.

Failure to follow these instructions will result in death or serious injury.

SRYLPD1/SRYLPD2/SRYLPD3/SRYLPD4

NOTE: SRYLPD1 is used for the purpose of illustration. The process is applicable to SRYLPD2, SRYLPD3, and SRYLPD4.

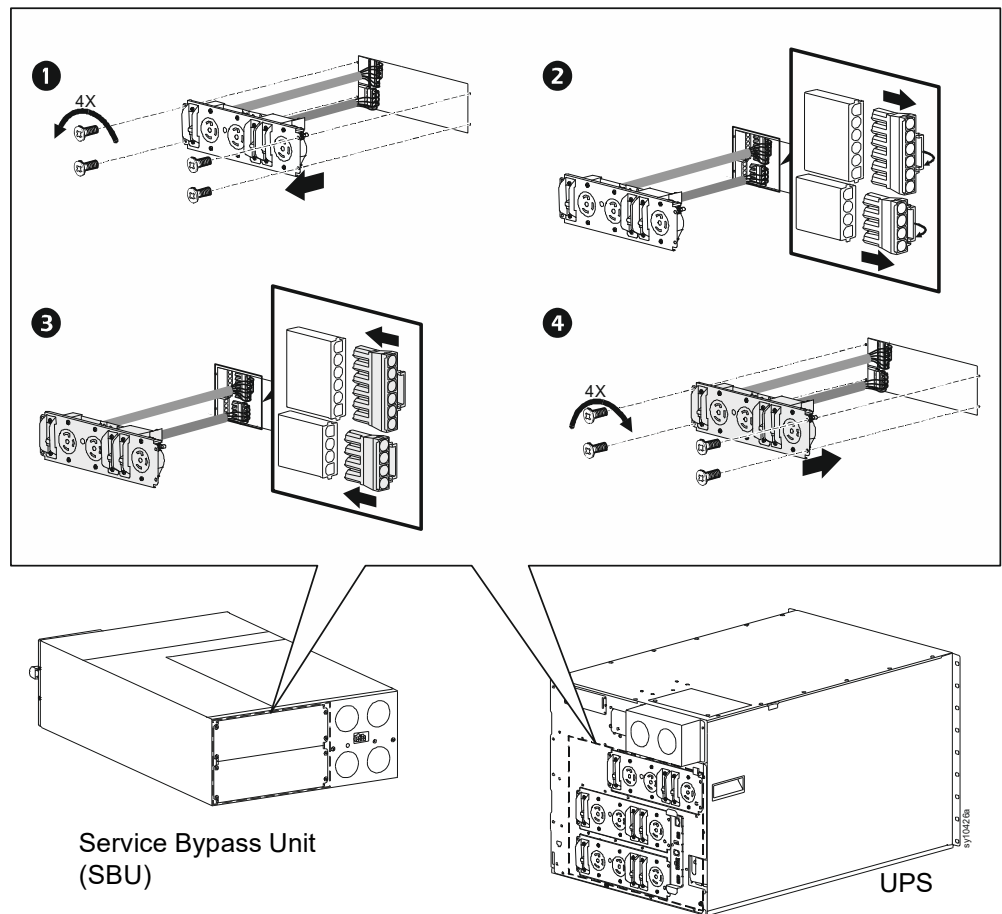

SRYLPD5/SRYLPD7

NOTE: SRYLPD5 is used for the purpose of illustration. The process is applicable to SRYLPD7 also.

